

Amico Alert-4 Conversion LCD Ethernet Area Alarm



Ethernet Ready:

View your alarms on your computer or mobile device.



Features:

- The LCD Alarm shall be capable of displaying an exact replica of the alarm on a computer screen via the facility's ethernet or internet. In addition, an exact image of the alarm can be displayed on a mobile device.
- The LCD Alarm will update its status every second.
- Self diagnostic and error message display for ease of maintenance.
- Easy access via Amico Medgas App (Apple and Android).
- Web Audio Enable: Web Audio will trigger when alert occurs via ethernet.
- Unlimited records of history log to keep track of alert history for easy troubleshooting.


General Specifications:

The Digital LCD Area Alarm system shall be an Amico Alert-4 series, complete with a five-year warranty.

The LCD alarm shall be microprocessor based with a 10" (25.4 cm) screen and capable of monitoring up to 8 sensors. Sensors shall be mounted locally (in the rough-in box) by installing the copper pipe provided or mounted remotely. Sensors will be automated for gas specific detection.

Each sensor unit is gas specific, with an error message display for an incorrect connection.

Each gas service shall be provided with a digital read-out comprising of 0-249 psi (0-1,717 kPa) for pressure and 0-30" Hg (-100-0 kPa) for vacuum. The digital read-out shall provide a constant indication of each gas being measured, indicating a green "NORMAL" and a red "HIGH" or "LOW" alarm condition.

If an alarm occurs, the green indicator will change to red and a continuous audible alarm will sound. Pushing the  (mute button/push to test button) will cancel the audible alarm, but the unit will remain in the alarm condition until the problem is rectified.

The default set-points shall be +/- 20% variation from normal condition. In the calibration mode, High/Low set points shall be adjustable by Setup button and selecting set points with up and down buttons. To view the set points, press and hold the mute button for twenty (20) seconds.

The box shall be fabricated from 18 gauge (1.3 mm) steel with a 3/8" (9.53 mm) O.D. type "K" copper pipe for connection to the service line. The box mounting brackets shall be adjustable to accommodate for different wall thickness.

LCD Sensor operating pressure range:

- Mid-Pressure: (0 psi to 99 psi) - OXY, AIR, N₂O, CO₂
- High Pressure: (0 psi to 249 psi) - NIT, IAR
- Vacuum: (0 to 30 inHG) - VAC, WAGD, AGSS

Input power to the Amico Alert-4 Series LCD Ethernet Area Alarm is: 115-220 VAC, 50-60 HZ.

The Amico Alert-4 Series LCD Area Alarm is Ethernet ready, for use with Internet Explorer, Google Chrome and Safari.

Amico products comply with NFPA 99, CSA Z7396.1 and CSA Z305.1.

Technical Specifications

Front View

Top View

Side View

Number of Display Modules (existing)	A (Filler Box)	B (Filler Box)	Number of Gangs
From 1 to 2 modules	12.75 (324)	N/A	3
From 1 to 3 modules	16 (406)	16.25 (413)	4
From 1 to 4 modules	19.3 (490)	19.56 (497)	5
From 1 to 6 modules	25.9 (658)	26.25 (667)	7

Filler Frame Part Numbers

A3P-LCD-FILLER-4	Alert-3 LCD Conversion Alarm Filler Frame 4-Station
A3P-LCD-FILLER-5	Alert-3 LCD Conversion Alarm Filler Frame 5-Station
A3P-LCD-FILLER-7	Alert-3 LCD Conversion Alarm Filler Frame 7-Station

IMPORTANT NOTE:

Due to unknown factors of the existing equipment, projects requiring Retro-Fit Conversions must be fully investigated by the installer.

It is the responsibility of the installer to determine if the Retro-Fit will function correctly and if additional components are required. Amico is not responsible for any additional components required.

Model Numbers

A4AC-L-XXXXXXXX

Conversion (Retro-Fit) = C

The Letter "L" Defines the Language:

English (NFPA)	=	U
English (CSA/ISO)	=	E
French (CSA/ISO)	=	F
Spanish (NFPA)	=	S

The Letter "X" Defines the Type of Gas:

Oxygen	=	O	Carbon Dioxide	=	C
Medical Air	=	A	WAGD (NFPA)	=	W
Medical Vacuum	=	V	AGSS (ISO)	=	E
Nitrous Oxide	=	2	Instrument Air	=	I
Nitrogen	=	N			


Example:

If the Alarm is converting from an Ohio Alarm consisting of oxygen, medical air and vacuum then the following part number is applicable for the conversion = **A4AC-U-OAV**

Notes:

1. An LCD Filler Frame is required if the existing alarm width is more than 10 inches.
2. Specify if converting from digital or analog. Please also note if there are any special requirements.
3. An Ohio Alarm requires a trim plate to cover the bottom gap.


Amico Mobile Eco System App

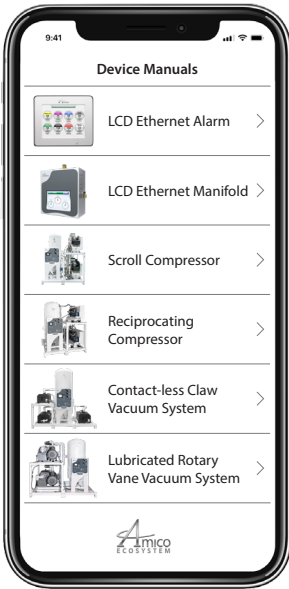

Downloads



Actual Display

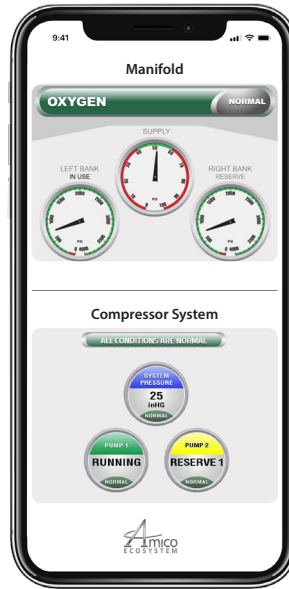

Actual Display

Features:

- Email and Text notification
- Easy access via Amico App, will have peace of mind knowing medical alarm always connected.

Capable of sending email or text messages when in fault condition. Email and text messages will also provide panel URL and location installed for easy access. By clicking URL, an exact image of the panel screen will display on mobile devices.

Amico Mobile Eco System App is available on the Apple App Store & Google Play to download. It will provide an exact and instant visual representation of the alarm conditions to eliminate the need for nurses to call maintenance personnel in the event of a gas outage. The App will also help maintenance personnel to localize the outage for quicker resolution.

Amico Mobile Eco System App is available on the App Store & Google Play.



AMICO MOBILE ECO SYSTEM APP
Download Now!



Distributed By:

